



Alarm Splitter Module Modification for -48V DC Power

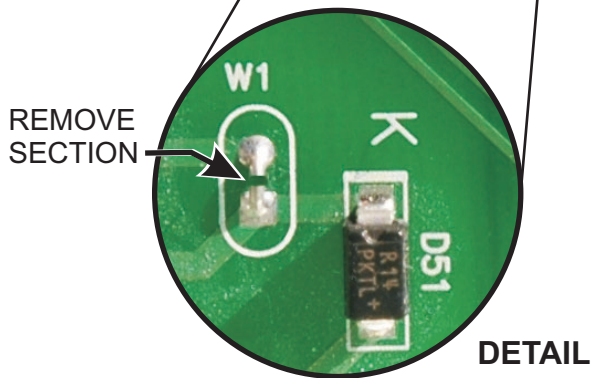

Note:
To use 48 volt power supplied to Alarm Splitter Module (Part No. 9800-4451), remove module cover and cut section out of W1 Jumper on board, as shown.

System Studies Incorporated

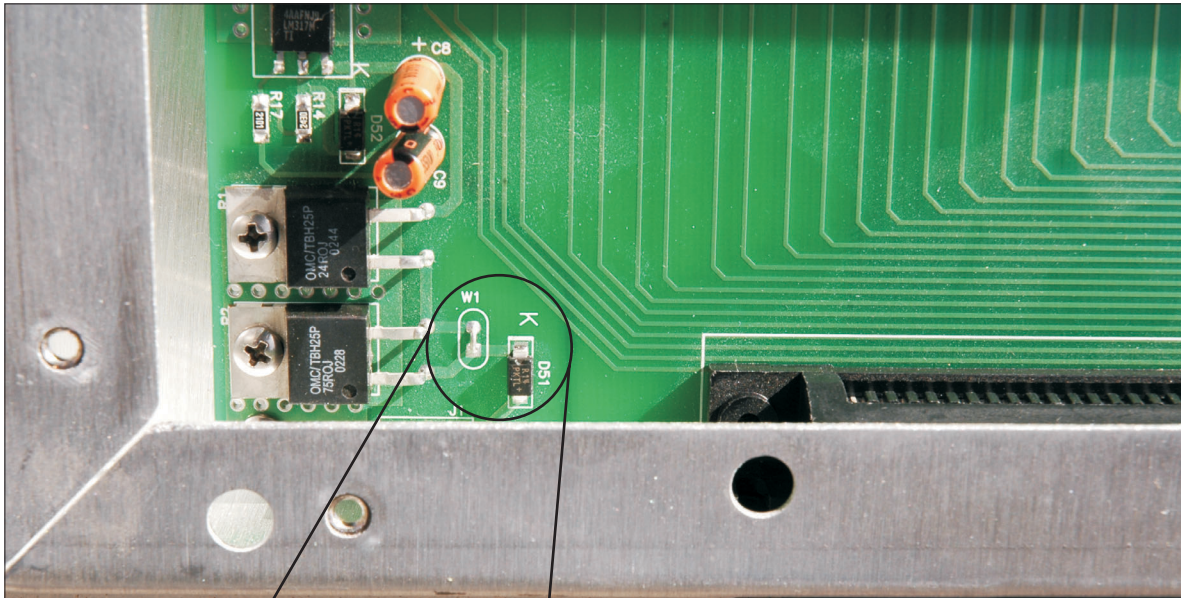

2-1340 East Cliff Drive
Santa Cruz, CA 95062
(831) 475-5777
(800) 247-8255
(831) 475-9207 FAX
www.airtalk.com